

NOTES:

1. ON SITE CONTACT:
2. SITE COMPLETION DATE (BOTTOM LIFT AND HYDRANTS INSTALLED/SERVICEABLE)- APRIL 2019
3. CONSTRUCTION FENCE IS TO BE PLACED AROUND PERIMETER OF SITE.
4. CONSTRUCTION ACCESS WILL OCCUR AT DESIGNATED OPENINGS AT THE CONSTRUCTION FENCE.
5. EMERGENCY LANES MARKED AS REQUIRED BY WMFD
6. WORKER AND SUB-CONTRACTOR PARKING AREAS- DESIGNATED LOCATION, DESIGNATED ON STREET AREAS, AND BEHIND THE SALES AND CONSTRUCTION TRAILER.
7. NO PARKING WILL BE ALLOWED IN FIRE LANES AND IN FRONT OF FIRE HYDRANTS.


FIRE FLOW DATA

BLOCK 1, BLOCK 2 (UNITS 6-17), BLOCK 4, BLOCK 5, BLOCK 6
 TOTAL FIRE FLOW REQUIRED IS 1,500 GPM MINIMUM AT 20 PSI RESIDUAL PRESSURE FOR 2 HOURS.
 THIS FLOW MUST BE PROVIDED FROM A MINIMUM OF 1 HYDRANT. EACH FIRE HYDRANT MUST SUPPLY 1,500 GPM AT 20 PSI RESIDUAL PRESSURE.
 CODE USED FOR ANALYSIS: 2009 IFC 2011 AMENDMENTS
 CONSTRUCTION TYPE: V-A
 FIRE FLOW CALCULATED AREA: 2090 SF
 THESE UNITS WILL NOT BE SPRINKLERED.

BLOCK 2 (UNITS 1-5) AND BLOCK 3 (UNITS 1-18)
 TOTAL FIRE FLOW REQUIRED IS 1,500 GPM MINIMUM AT 20 PSI RESIDUAL PRESSURE FOR 2 HOURS.
 THIS FLOW MUST BE PROVIDED FROM A MINIMUM OF 1 HYDRANT. EACH FIRE HYDRANT MUST SUPPLY 1,500 GPM AT 20 PSI RESIDUAL PRESSURE.
 CODE USED FOR ANALYSIS: 2009 IFC 2011 AMENDMENTS
 CONSTRUCTION TYPE: V-A
 FIRE FLOW CALCULATED AREA: 2090 SF
 THESE UNITS WILL BE SPRINKLERED.

LEGEND

- PIPE AND STORAGE YARD
- FIRE ACCESS LOOP

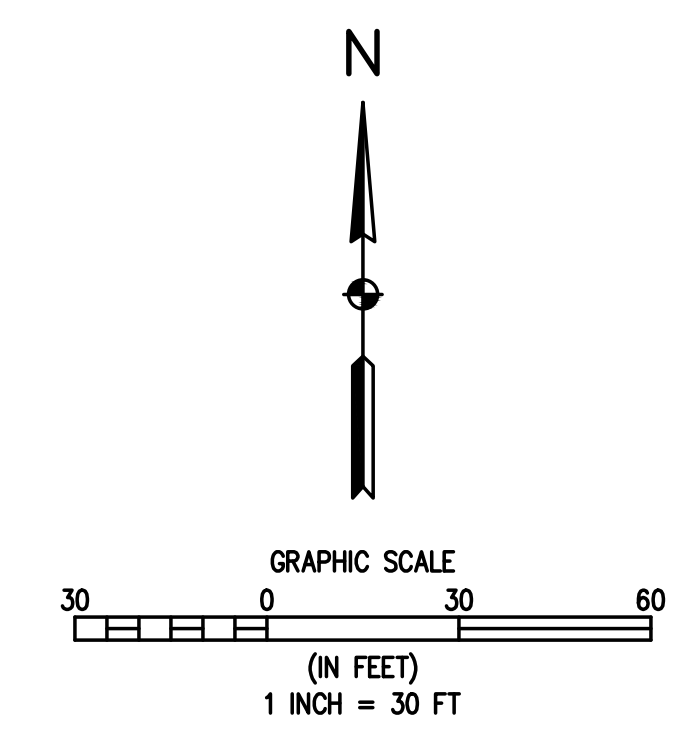

DESIGNED BY	DRAWN BY	CHECKED BY
DATE		
PREPARED BY		
REVISION DESCRIPTION		

PREPARED UNDER THE DIRECT SUPERVISION OF