


WEST METRO FIRE PROTECTION DISTRICT

Residential Sprinkler Requirement by Location

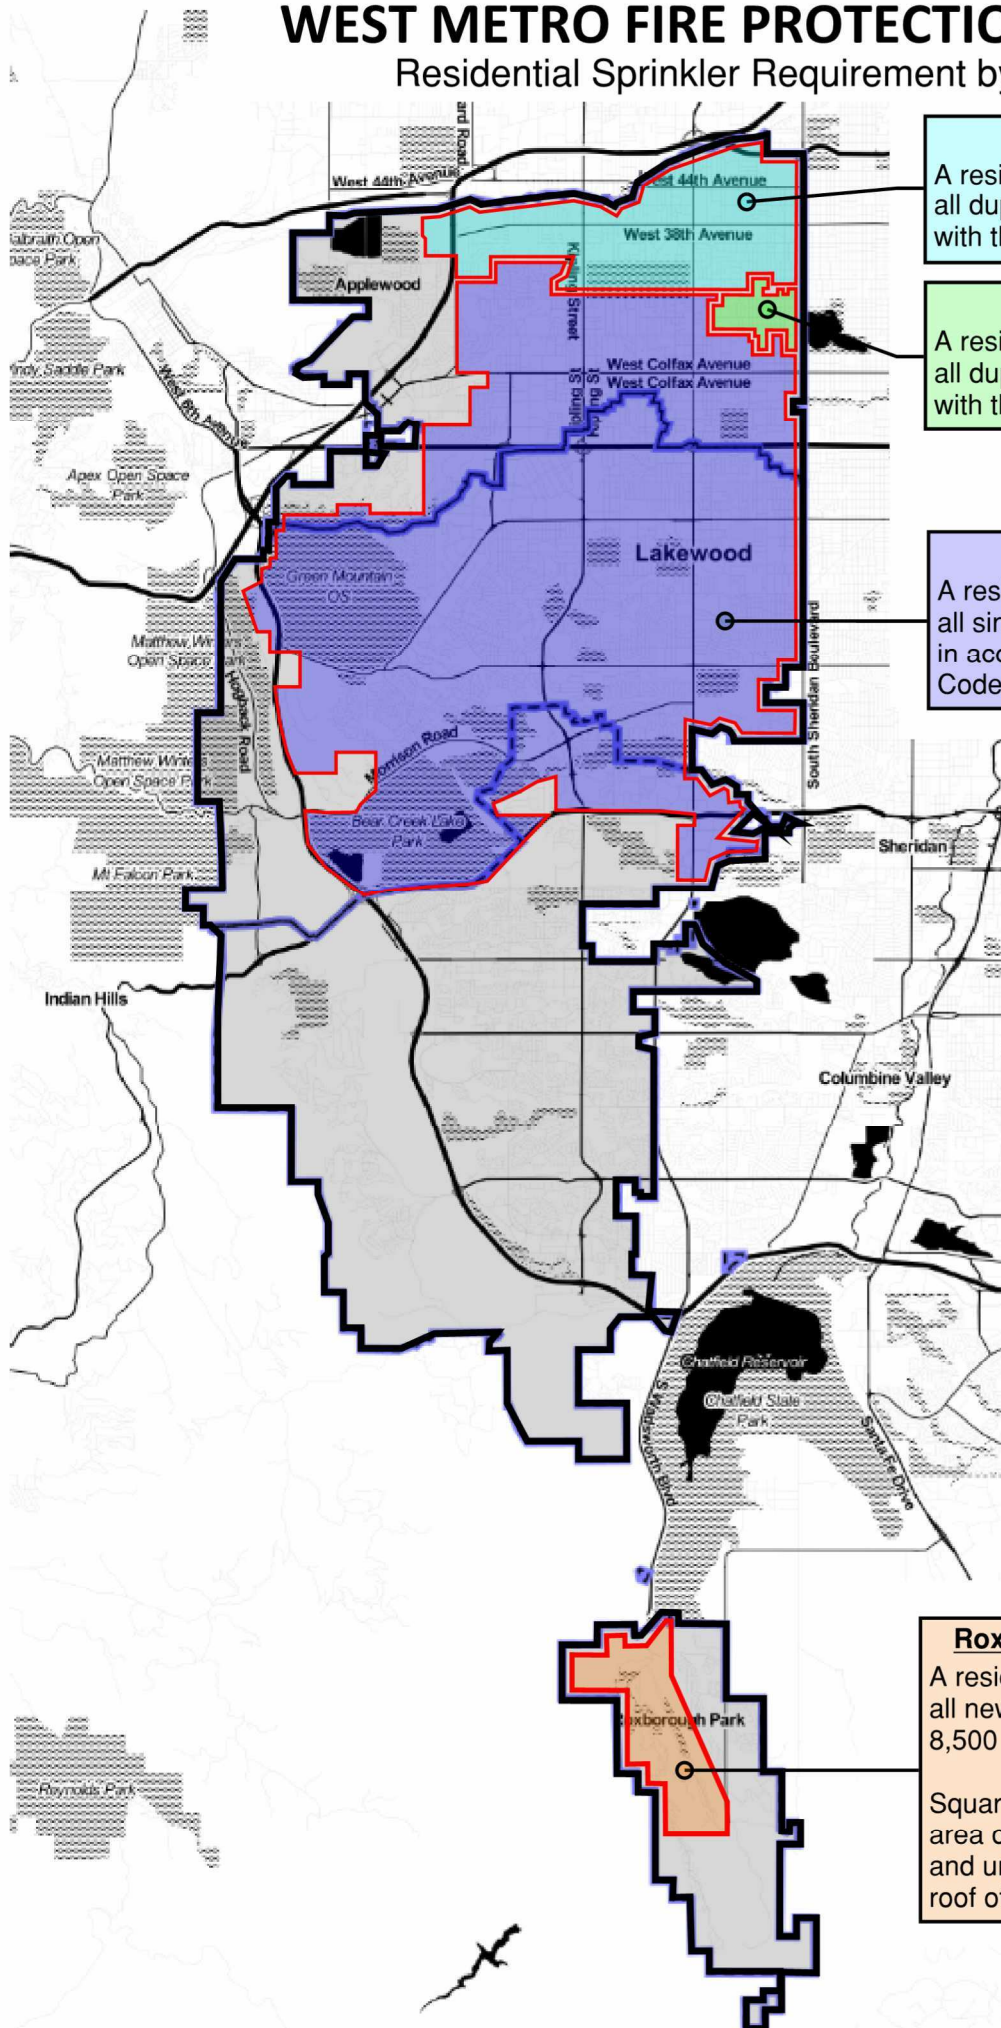

City of Wheat Ridge CO

A residential fire sprinkler system is required in all duplex and townhouse units in accordance with the International Residential Code (IRC).

City of Edgewater CO

A residential fire sprinkler system is required in all duplex and townhouse units in accordance with the International Residential Code (IRC).

City of Lakewood CO

A residential fire sprinkler system is required in all single family, duplex, and townhouse units in accordance with the International Residential Code (IRC).

Roxborough Park Ravenna Community

A residential fire sprinkler system is required in all new single family residences exceeding 8,500 sq. ft.

Square footage is determined by total floor area of all floor levels within the exterior walls, and under the horizontal projections of the roof of a building, including garages.